

TELANGANA STATE DISASTER RESPONSE AND FIRE SERVICE DEPARTMENT.

ANNEXURE - I

(Annexure to G.O.Ms.No.56, Home (Ser.IV) Department, Dated:26.07.2019
Instructions to be followed for schools existing before 13.04.2009:

SELF CERTIFICATION FORM:-

Self certification of Fire safety Measures by School Management :


i) General Information for school buildings of all categories i.e., A,B,C&D.


Sl.No	Details	
1	Date of the opening of the school building	16-01-2000.
2	Name of the applicant	M.A. QAVI BAHELMI
3	Name and Address of the school	VIDYA NIKETAN HIGH SCHOOL , NARSANNAPALLY, KAMAREDDY.
4	Telephone Number and email of the Applicant	9666637363.
5	Height of the building (in meters)	06.40 .
6	No of floors	Ground + 1Upper floor
7	Abutting road width (in Meters)	12.00
8	Built up Area of each floor in Sq.Mtrs Stilt _____ Ground _____ Floor 1 _____ Total _____	05.25Acreas (plot area) 1327.50 0862.20 2189.70
9	Number of Staircases Staircase1 _____ (width in Mtrs) Staircase2 _____ (width in Mtrs)	02No's 01.35Mtrs 01.10Mtrs = 02.45mtrs
10	Width of each Staircase	01.10(approximately)
11	Open Spaces Front _____ (width in Mtrs) Side 1 _____ (width in Mtrs) Side 2 _____ (width in Mtrs) Rear _____ (width in Mtrs)	04.70Mtrs Nil 10.00Mtrs 02.00Mtrs

A)School Buildings With Ground Floor or Ground plus one upper floor.


Sl.No	Fire equipment required	Scale of fire equipment as per Norms	Required	Provided Yes/No
1	Fire extinguishers (IS 2190:2010)	Two 9ltrs water, ABC 4Kgs for every 200Sq.mtrs	11	Yes (15No's)
2	Automatic Sprinkler System (IS 15105:2002).	To be installed in basement. If area of basement exceeds 200 square meters	N/A	N/A

Note: For Ground + 1Upper floor buildings, if the floor area in a single floor is more than 500 Sq.Mtrs and if there is only single staircase, a second staircase of 1.5 Meters Width shall be provided with concrete/Metal steel structure.


Signature with date of School authority and Seal



35/DFO/mdk/2020.

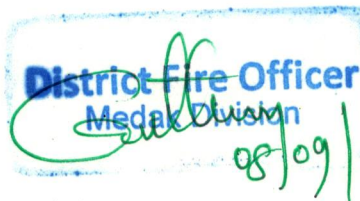

VIDYA NIKETAN HIGH SCHOOL
PATAHA RAJAMPET - NARSANNAPALLI
KAMAREDDY, 502 102 (TS)

II) General Fire safety measures which should be followed by all Schools:

Sl.No	General Fire Safety Measures	Weather followed Yes/No
1	The school building shall not be housed in temporary structures with roofs of tent cloth, thatched or any other combustible materials.	Yes
2	It should be ensured that the available fire safety equipments is always in good working condition.	Yes
3	Pre- school, kinder garden and class/grade 1 students shall be located on ground floor/level of exit discharge and class/grade 2 students shall be located not above one floor higher than ground floor/level of exit discharge.	Yes
4	Kitchen should be constructed/ provided away from the school building.	N/A
5	All schools shall prepare an evacuation plan in consultation with local fire officer.	Yes
6	All teachers / employees should be trained in operating the available fire safety equipments in the building.	Yes
7	All exits / escape routes shall be kept free from any obstructions for free passage in any case of any emergency.	Yes
8	All the internal staircase, lifts, lobbies and corridors should be adequately ventilated and illuminated.	Yes
9	If the school is provided with central air conditioning system all safety measures as per clause 10.1 of IS 14435:1997 should be followed.	N/A
10	School building shall be kept free from inflammable and toxic material. If storage is inevitable, they should be stored safely.	N/A
11	Any hazardous / combustible material / volatile flammable liquids shall not be stored in school buildings.	N/A
12	Dos and Don'ts in case of any fire/Emergency shall be properly displayed at Strategic locations of the building.	N/A
13	Auto glow sign Boards shall be provided indicating Exits/escape routes.	N/A
14	Electric wiring in the entire building shall be checked and certified by the competent authority.	Yes
15	Structural stability of the building shall be checked and certified by competent authority.	Yes
16	Public address system shall be provided for use in case of any emergency and the system shall cover entire building.	N/A
17	Detailed information regarding number of students in each class room and the number of teachers / employees working shall be displayed at strategic location of the building.	Yes
18	Display all emergency supporting numbers such as nearest fire stations, police stations, hospitals/ambulance etc. all floors and at strategic locations.	Yes
19	A pictorial map with the details of entries/ exits details of class rooms/ laboratories/staff rooms and open space (Assembly point) of the school building shall be prepared and displayed in strategic locations.	N/A
20	If Basement area of the building exceeds 200 sq.mtrs, required to provide	N/A

Automatic sprinkler system as per IS 15105:2002

We, Vidyaniketan High School Management/correspondent hereby certify that the information furnished is correct and if it is noticed at any time that the information provided is false, we understand that our school affiliation may be cancelled by the concerned authority. We have installed fire safety measures as per the Annexure I and undertake to maintain the same in good working condition at all times.

Agman
Signature with date of
School authority and seal
Name & Designation:

35/DFo/mdk/2020

VIDYA NIKETAN HIGH SCHOOL
PATHA RAJAMPET - NARSANNAPALLI
DIST : KAMAREDDY - 503 102 (TS)

